


FAST Certification Test #6

Response for a Gen Start, LOG, and TB Shutdown

AOC-15/50 Rigid-Hub, 3-Bladed Turbine

Flex Tower, Flex Blades, 0° Yaw, Flex DT, TEC Gen, No Dyn Stall, Tower Shadow, Dyn Inflow

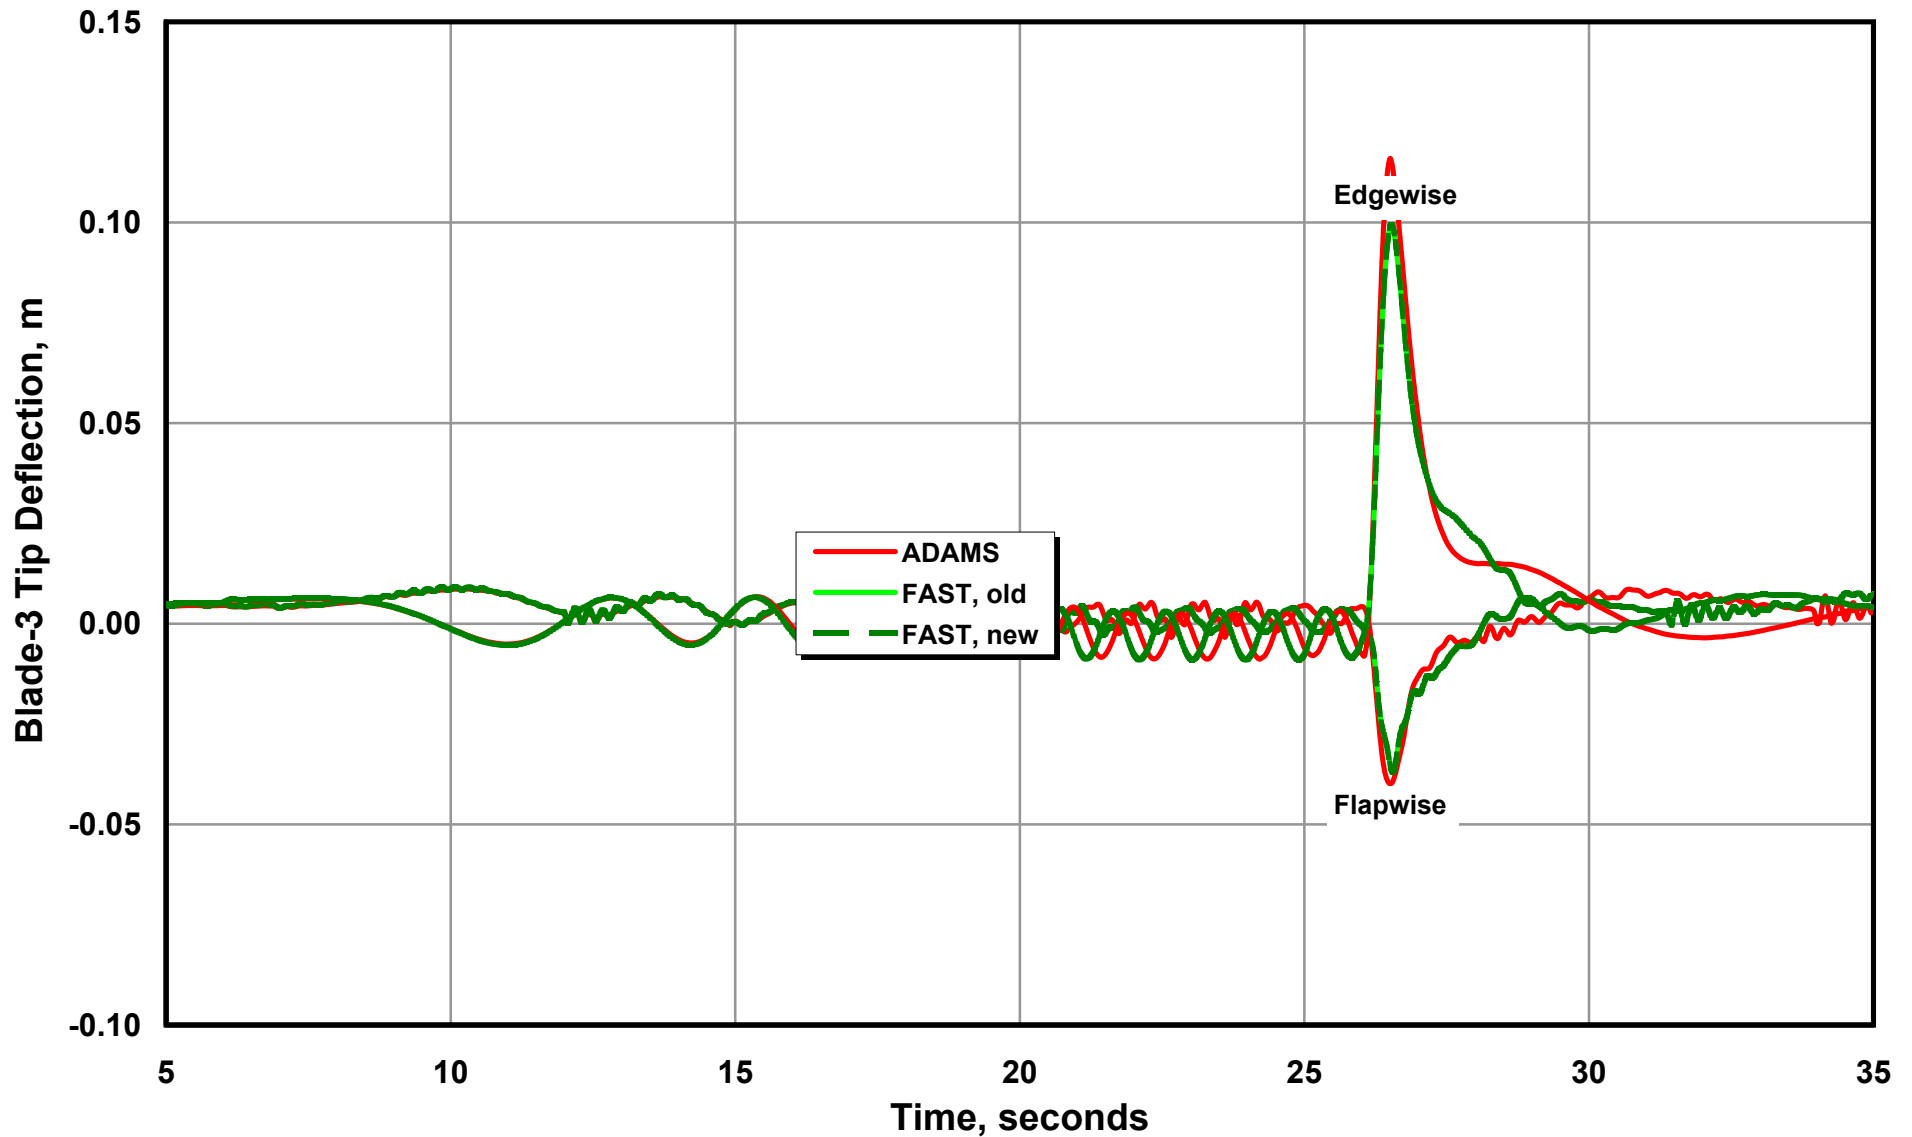


FAST Certification Test #6

Response for a Gen Start, LOG, and TB Shutdown

AOC-15/50 Rigid-Hub, 3-Bladed Turbine

Flex Tower, Flex Blades, 0° Yaw, Flex DT, TEC Gen, No Dyn Stall, Tower Shadow, Dyn Inflow

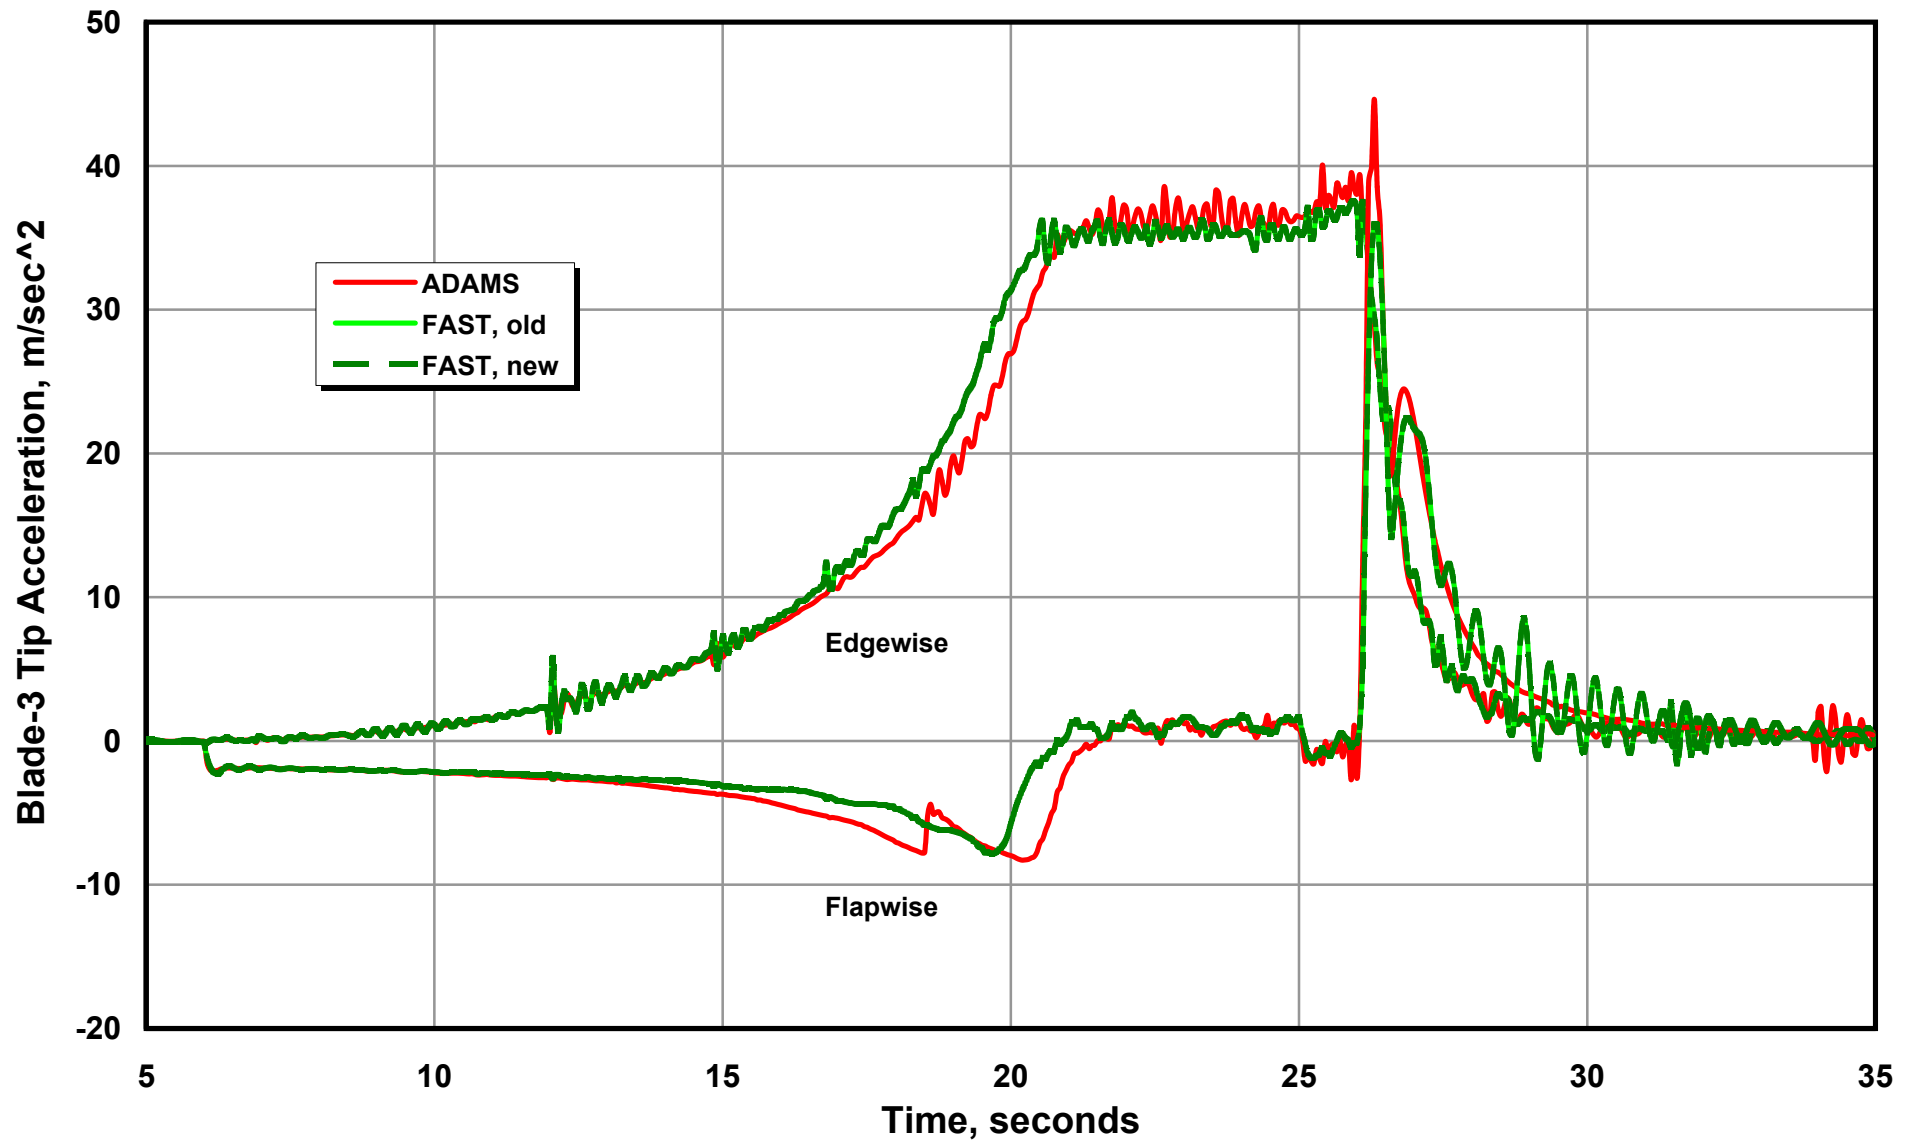


FAST Certification Test #6

Response for a Gen Start, LOG, and TB Shutdown

AOC-15/50 Rigid-Hub, 3-Bladed Turbine

Flex Tower, Flex Blades, 0° Yaw, Flex DT, TEC Gen, No Dyn Stall, Tower Shadow, Dyn Inflow

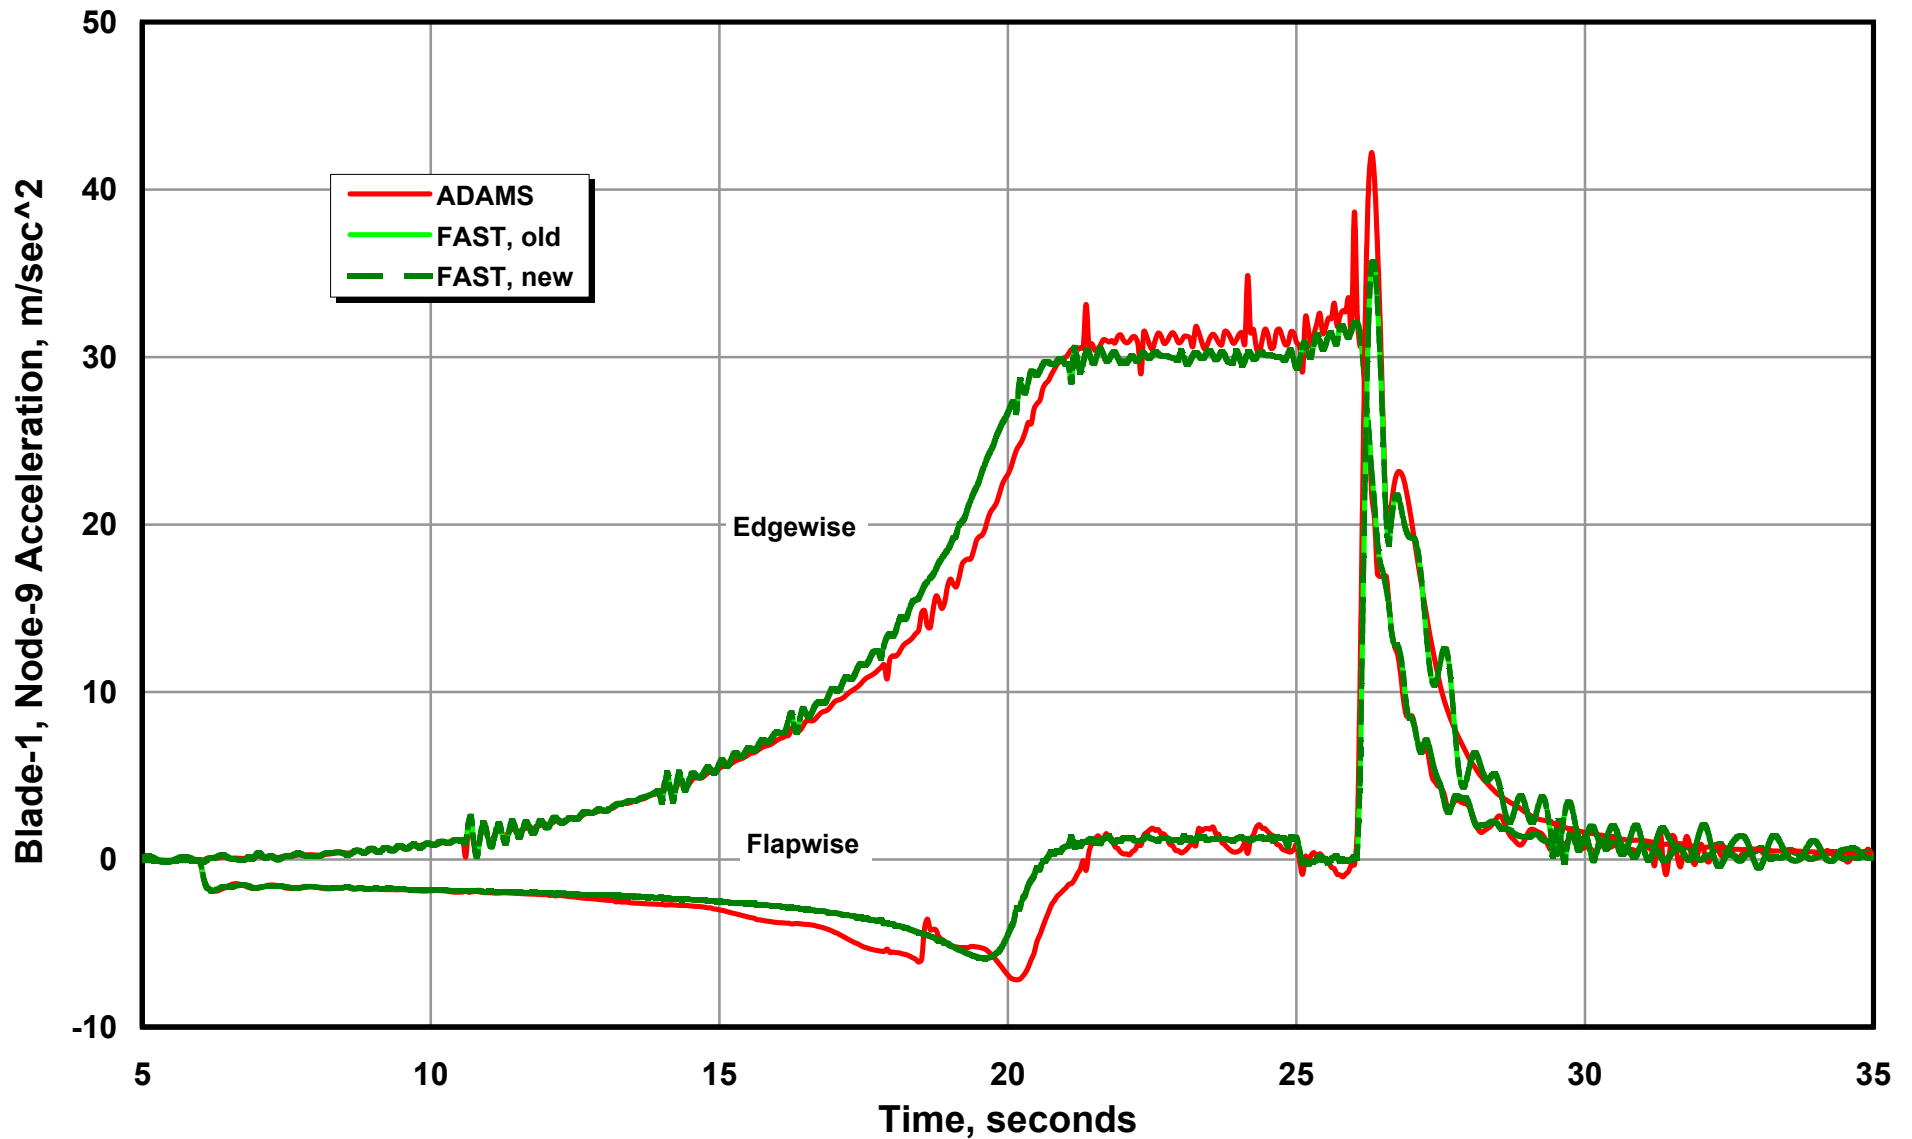


FAST Certification Test #6

Response for a Gen Start, LOG, and TB Shutdown

AOC-15/50 Rigid-Hub, 3-Bladed Turbine

Flex Tower, Flex Blades, 0° Yaw, Flex DT, TEC Gen, No Dyn Stall, Tower Shadow, Dyn Inflow

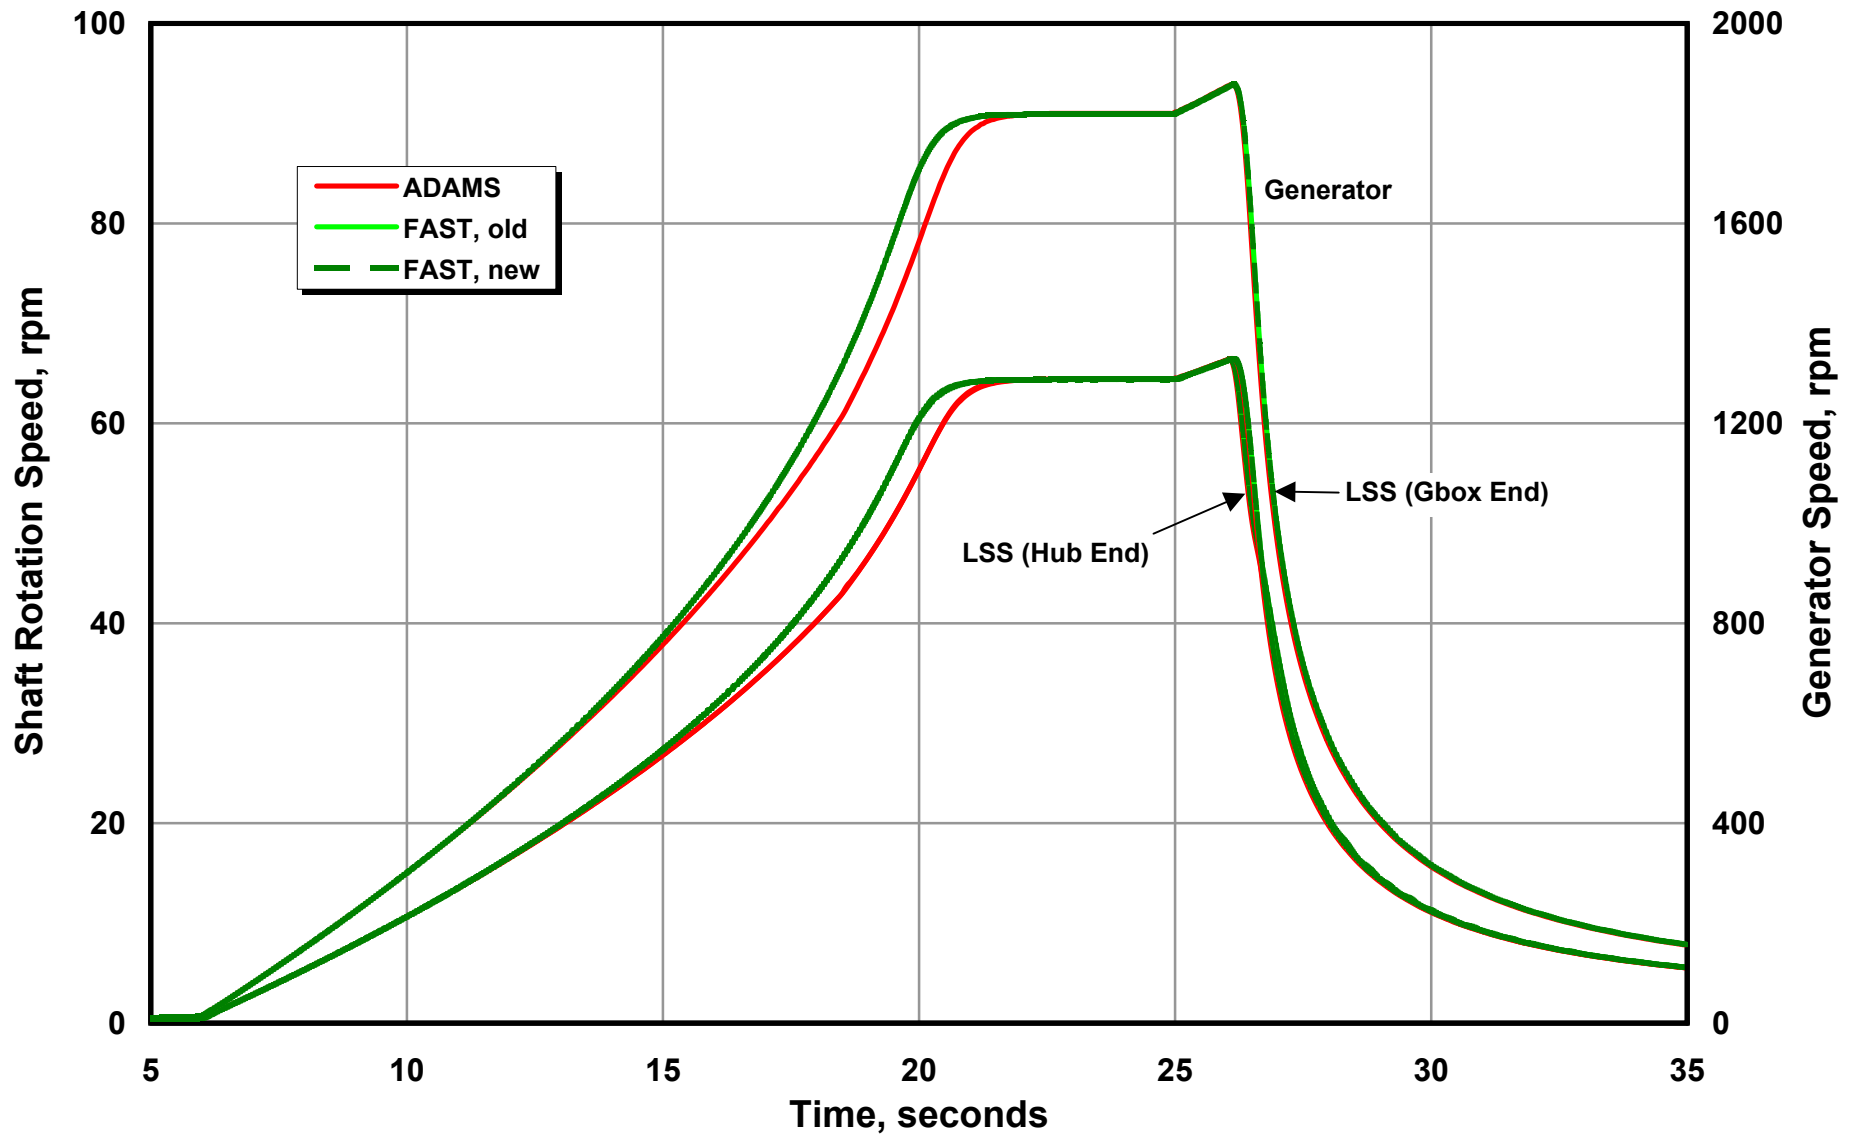


FAST Certification Test #6

Response for a Gen Start, LOG, and TB Shutdown

AOC-15/50 Rigid-Hub, 3-Bladed Turbine

Flex Tower, Flex Blades, 0° Yaw, Flex DT, TEC Gen, No Dyn Stall, Tower Shadow, Dyn Inflow

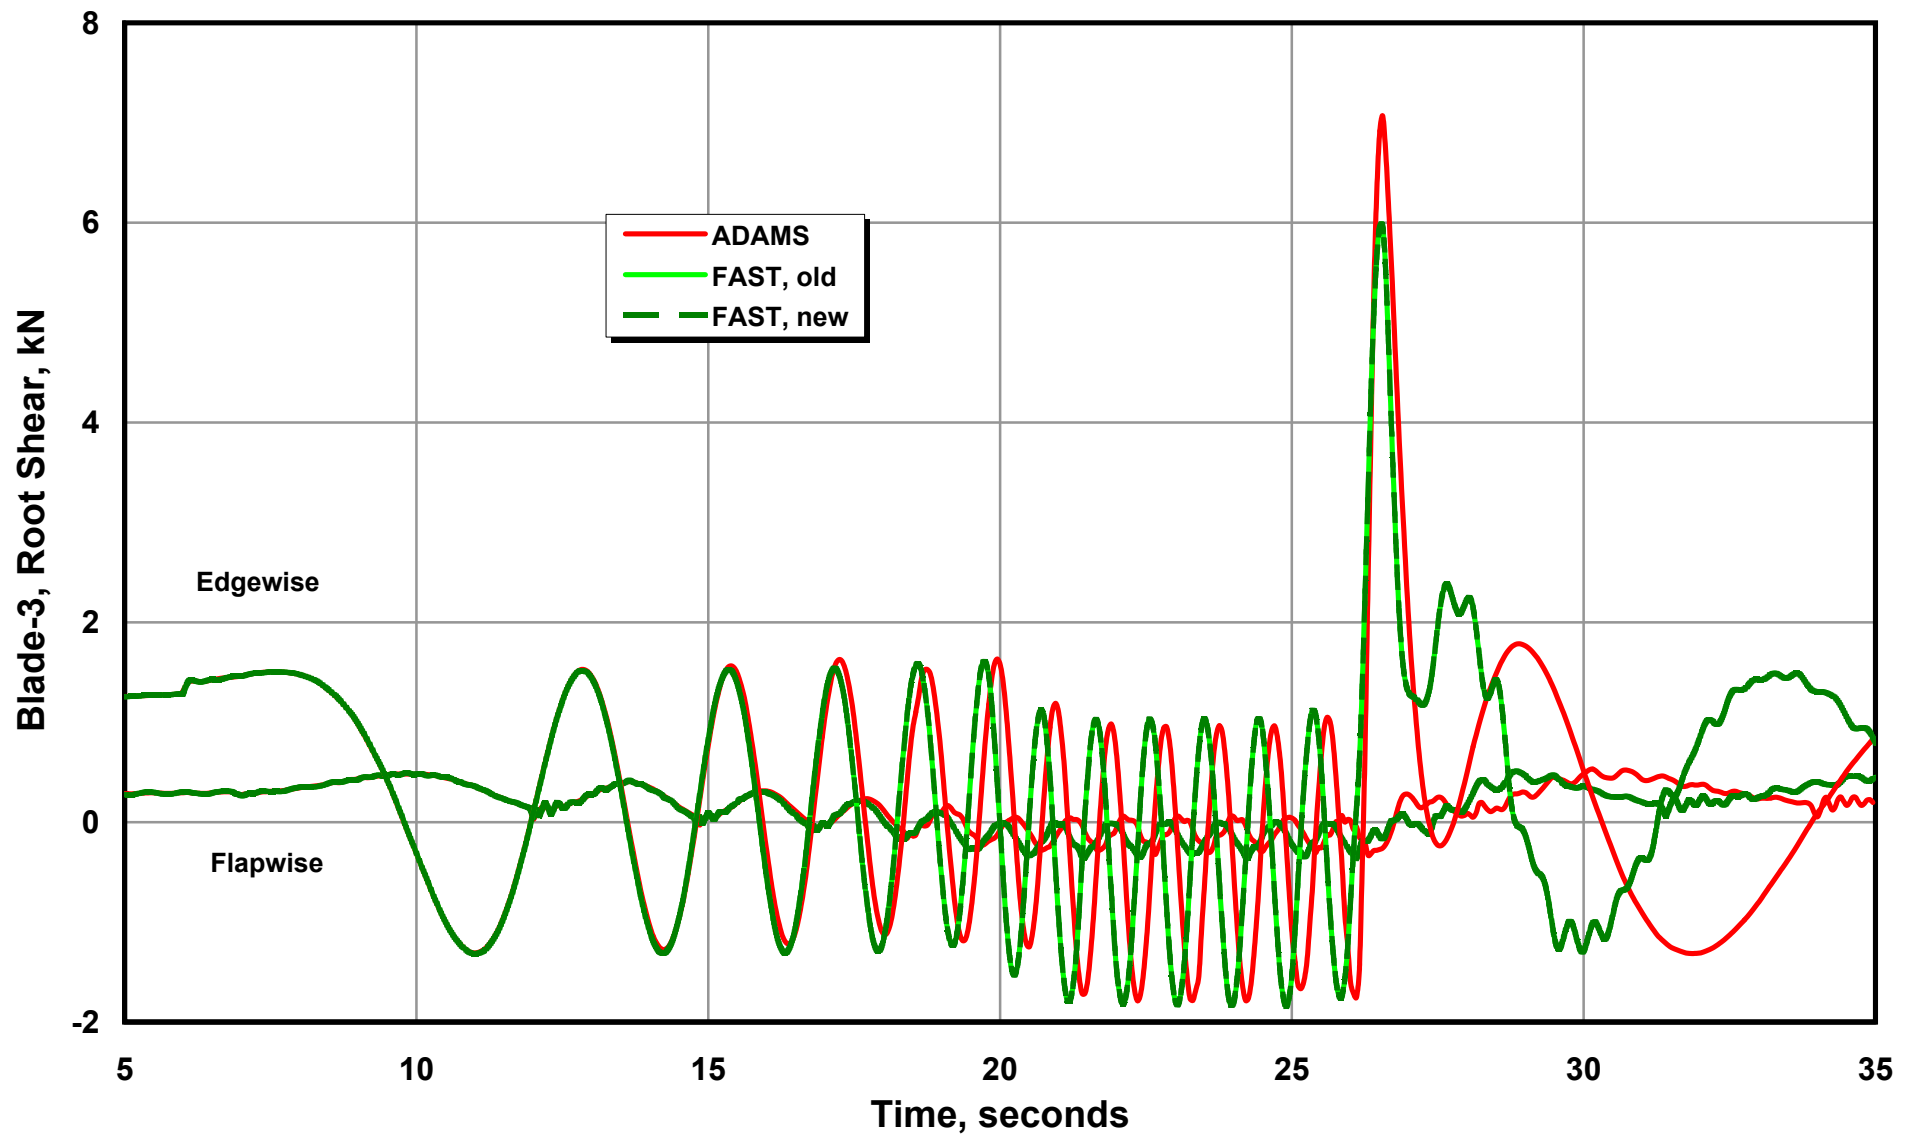


FAST Certification Test #6

Response for a Gen Start, LOG, and TB Shutdown

AOC-15/50 Rigid-Hub, 3-Bladed Turbine

Flex Tower, Flex Blades, 0° Yaw, Flex DT, TEC Gen, No Dyn Stall, Tower Shadow, Dyn Inflow

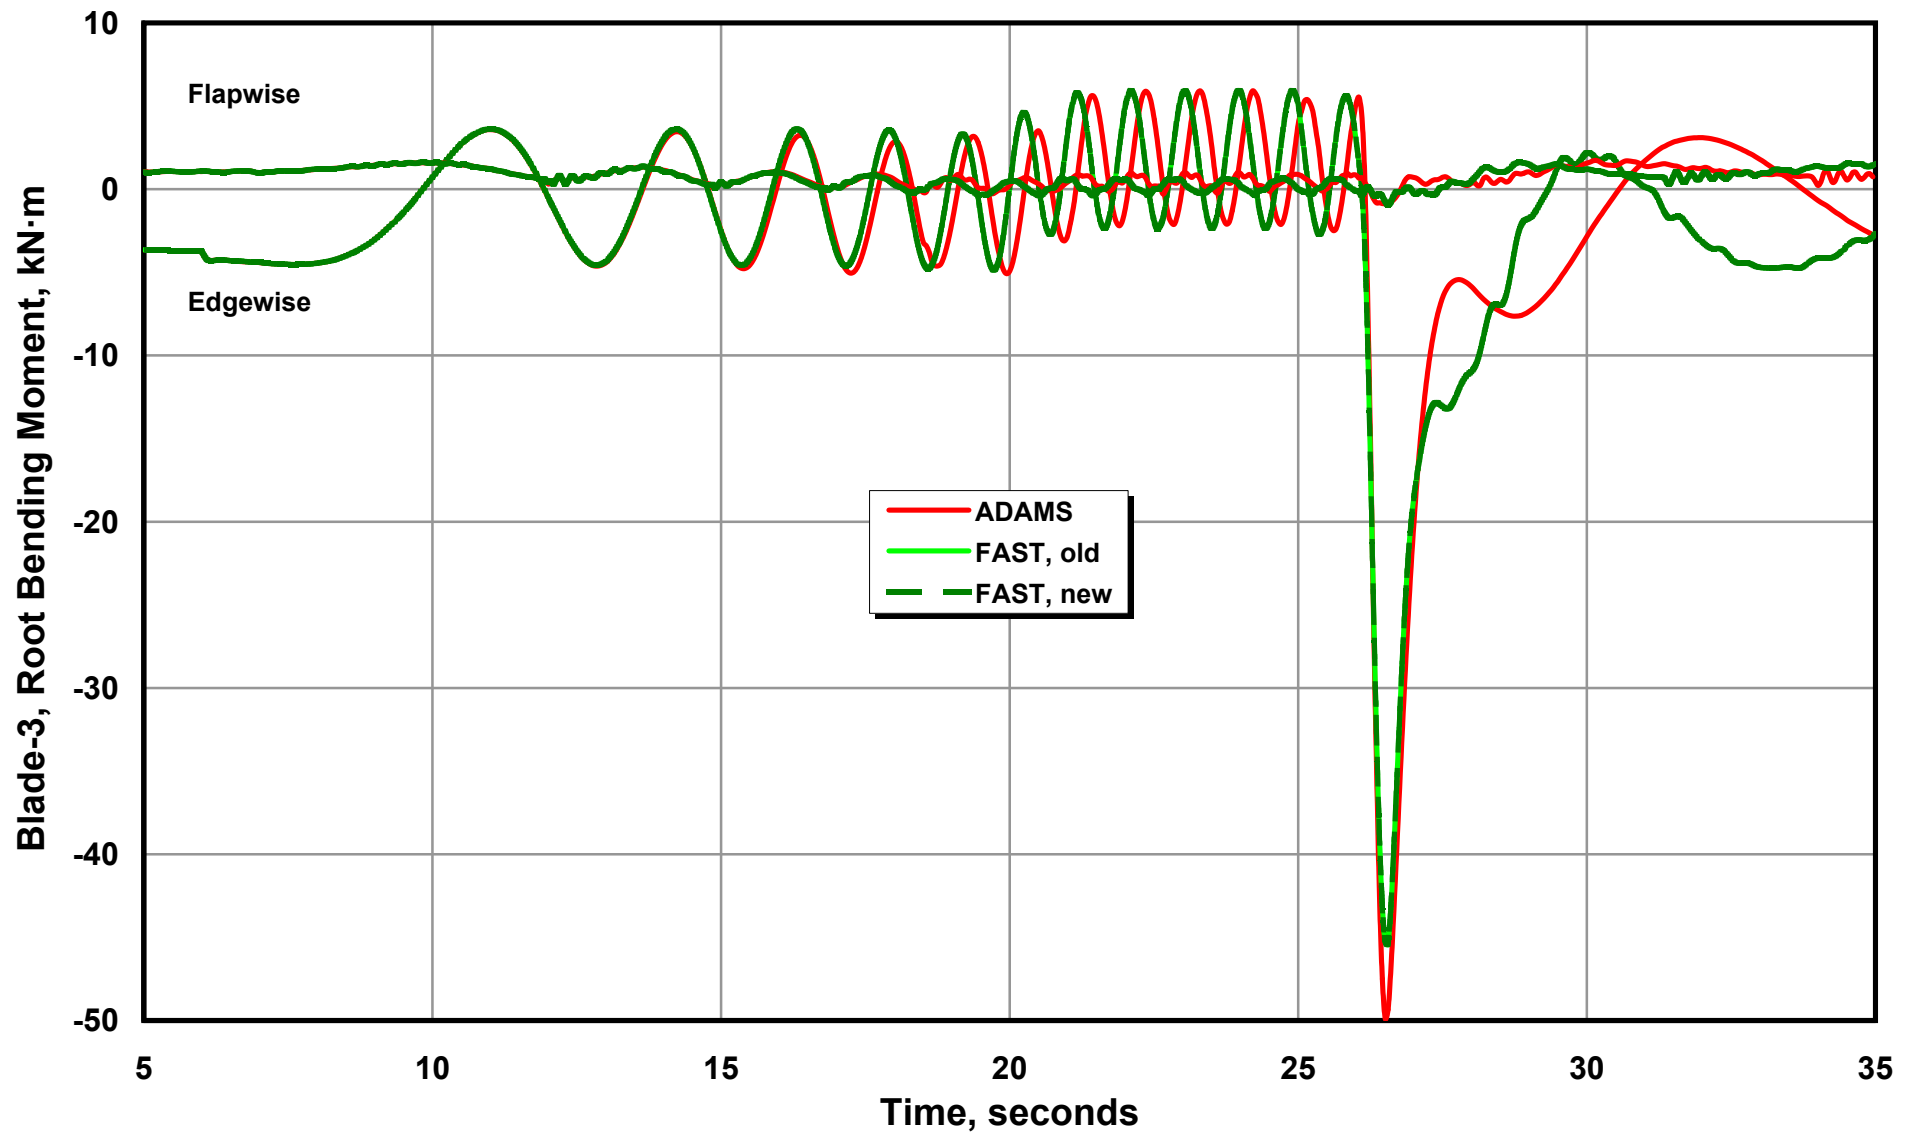


FAST Certification Test #6

Response for a Gen Start, LOG, and TB Shutdown

AOC-15/50 Rigid-Hub, 3-Bladed Turbine

Flex Tower, Flex Blades, 0° Yaw, Flex DT, TEC Gen, No Dyn Stall, Tower Shadow, Dyn Inflow

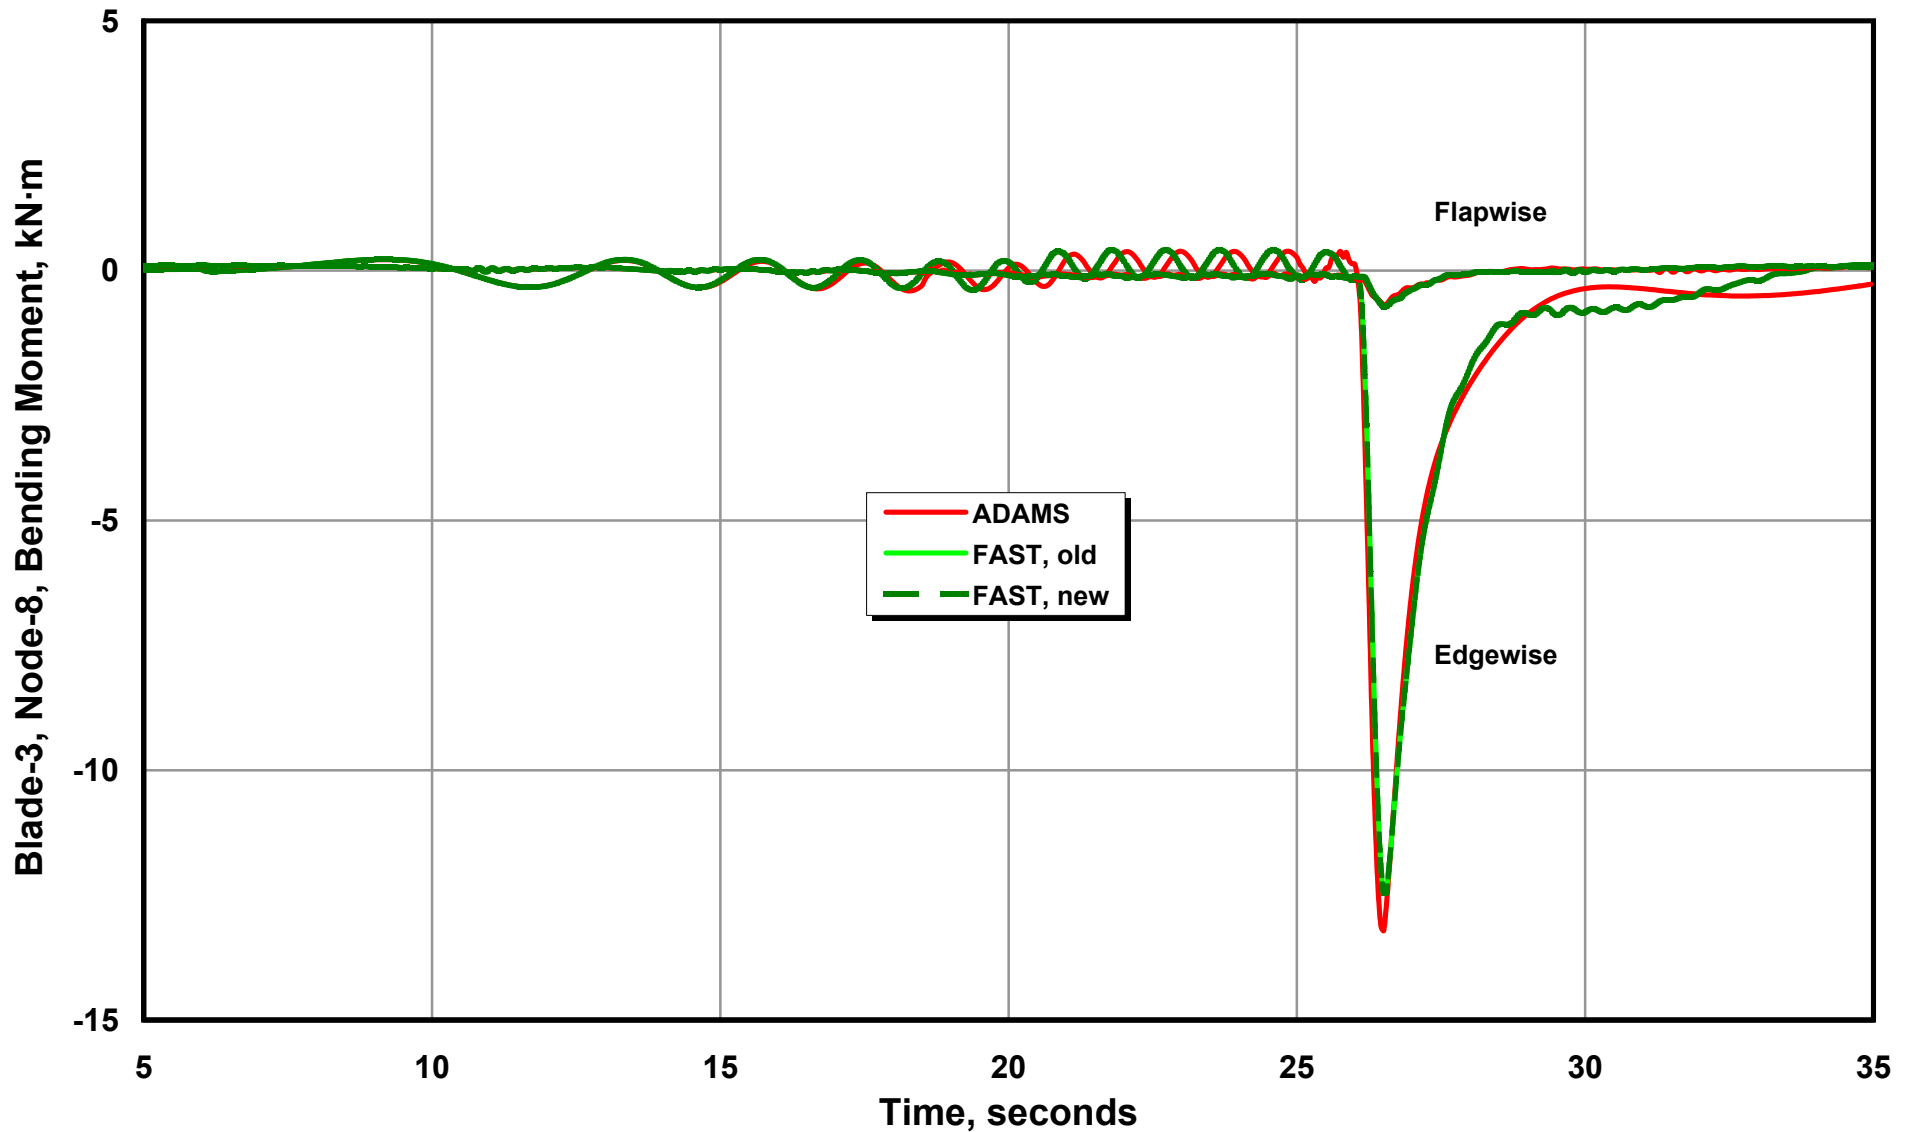


FAST Certification Test #6

Response for a Gen Start, LOG, and TB Shutdown

AOC-15/50 Rigid-Hub, 3-Bladed Turbine

Flex Tower, Flex Blades, 0° Yaw, Flex DT, TEC Gen, No Dyn Stall, Tower Shadow, Dyn Inflow

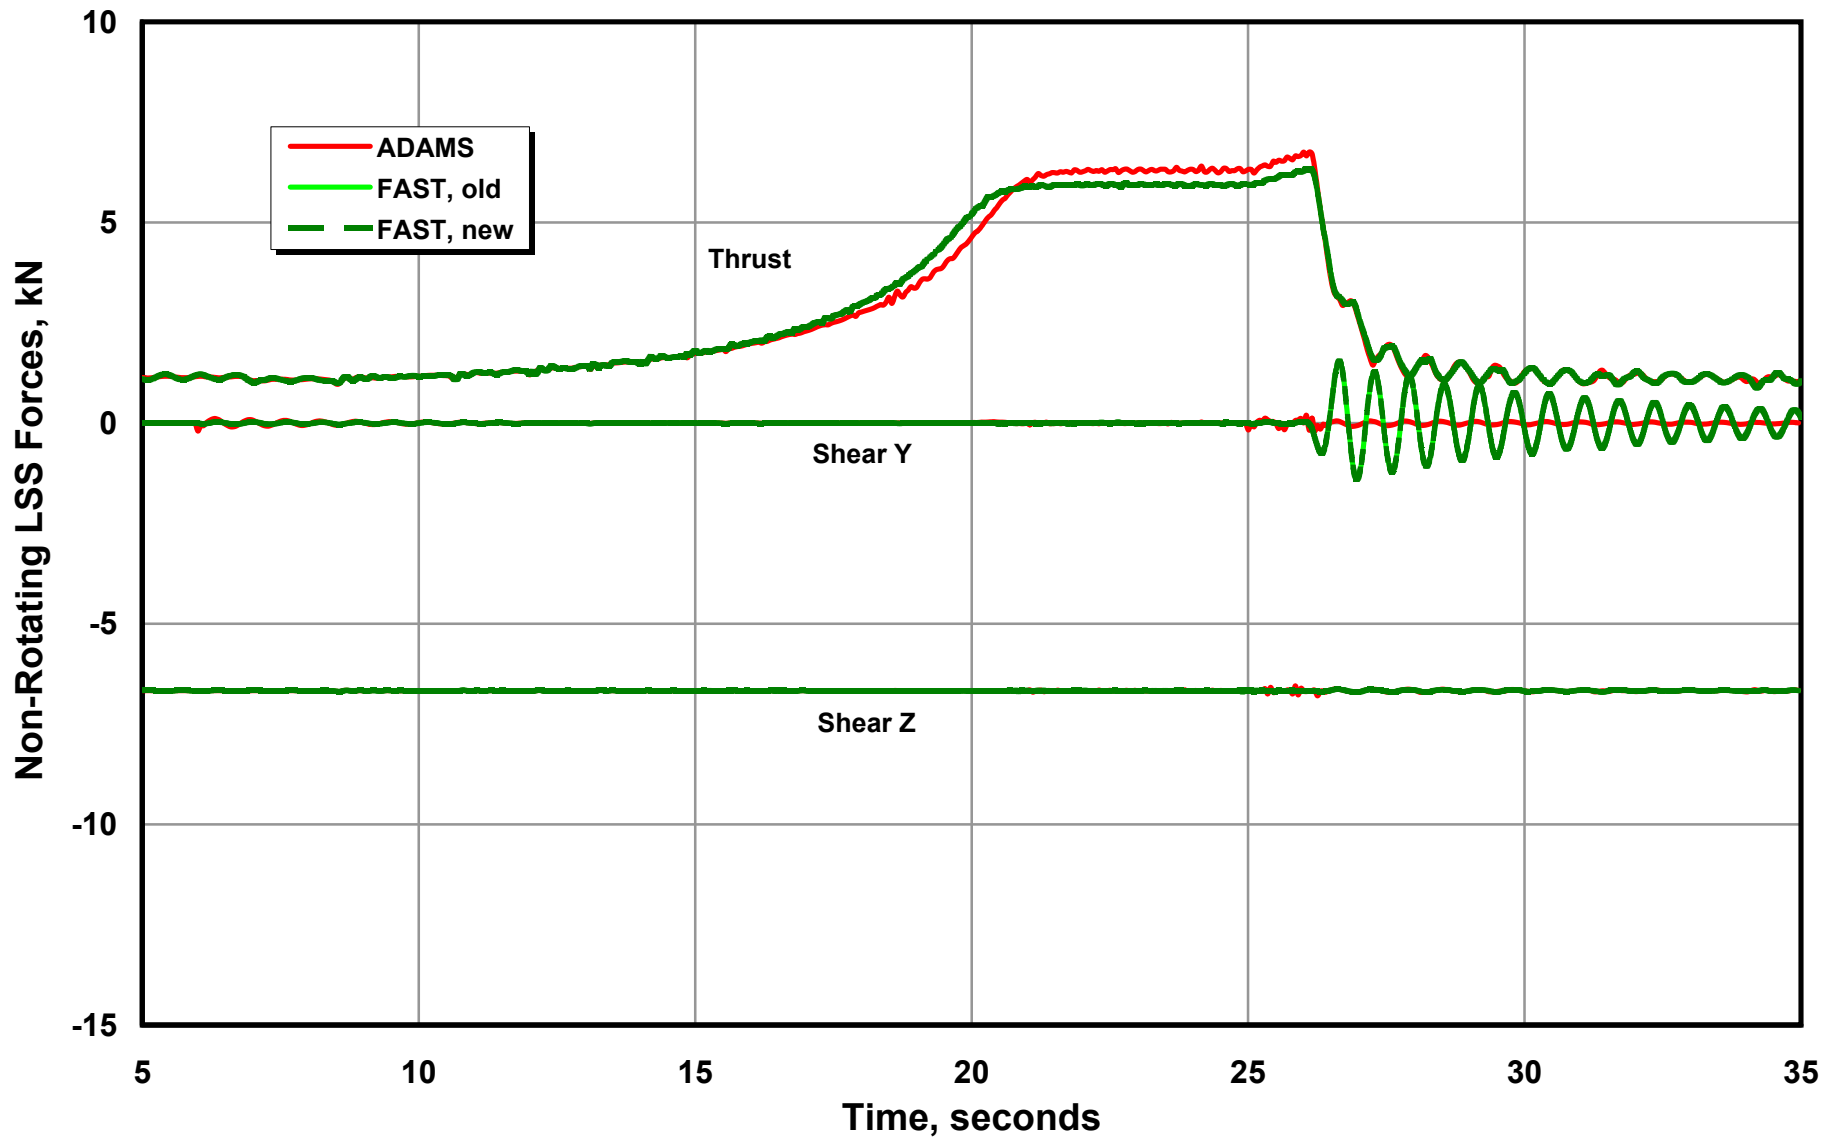


FAST Certification Test #6

Response for a Gen Start, LOG, and TB Shutdown

AOC-15/50 Rigid-Hub, 3-Bladed Turbine

Flex Tower, Flex Blades, 0° Yaw, Flex DT, TEC Gen, No Dyn Stall, Tower Shadow, Dyn Inflow

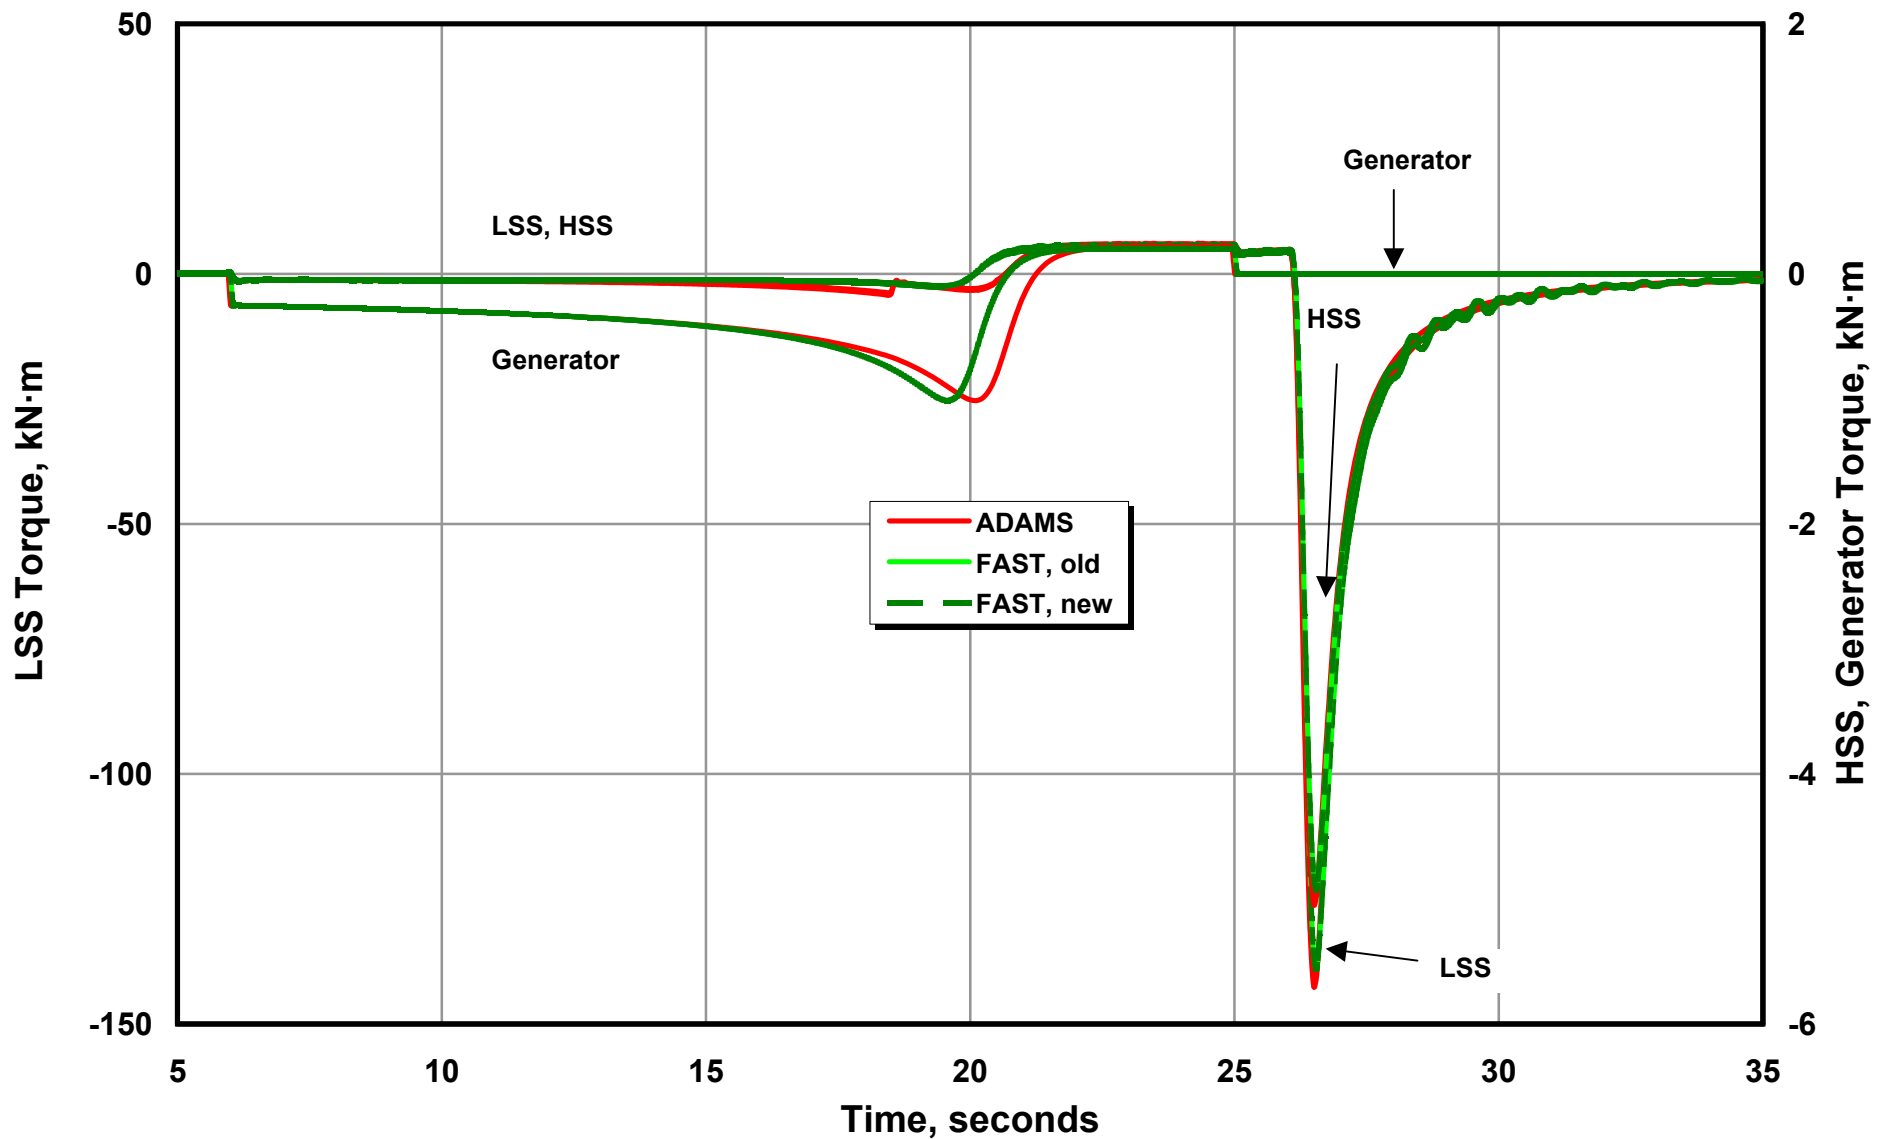

FAST Certification Test #6

Response for a Gen Start, LOG, and TB Shutdown

AOC-15/50 Rigid-Hub, 3-Bladed Turbine

Flex Tower, Flex Blades, 0° Yaw, Flex DT, TEC Gen, No Dyn Stall, Tower Shadow, Dyn Inflow

